

STATE OF NEBRASKA
DEPARTMENT OF ROADS
ADDENDUM NO. 1
AND
ELECTRONIC BIDDING SYSTEM
AMENDMENT NO. 1
PROJECT NO. EACNH-2-3(116)
CONTROL NO. 60937
CALL ORDER F27
ON N-2 BETWEEN ANSELMO AND MERNA
LETTING DATE: FEBRUARY 7, 2002

The Schedule of Items is amended as follows:

1. In Group 9, the bid item "Surfacing Under Guardrail" has been added with a quantity of 1,260.000 m2.
2. In Group 10, the quantity for the bid item "Rental of Motor Grader, Fully Operated" is incorrect. The quantity should read 60.000 Hour.
3. In Group 10, the quantity for the bid item "Rental of Dump Truck, Fully Operated" is incorrect. The quantity should read 200.000 Hour.

The EBS generated bid items sheet must show these corrections or the bid will be considered void.

* * * * *

The Special Provisions are amended to include the following:

SURFACING UNDER GUARDRAIL

Amend Section 503 in the Standard Specifications and Supplemental Specifications to include Surfacing Under Guardrail.

At the contractor's option, the surfacing may be constructed using Class "47B-3000" Concrete, Class "AX-3000" Concrete, Class "PR-3000" Concrete (Class 47B-20 Concrete, Class AX-20 Concrete, Class PR-20 Concrete), or any commercially produced hot mix asphaltic concrete, which has been approved by the Engineer. These materials may be used interchangeably during the course of the work except that surfacing at any individual location must be completed with the same material with which the work was begun.

If concrete is used in the surfacing, it shall reach a minimum strength of 3000 psi (20 Mpa) before opening to traffic.

Amend Subsection 302.04 in the Standard Specifications to provide that the work of subgrade preparation for surfacing under guardrail will not be measured for payment, but shall be considered subsidiary to the item "Surfacing Under Guardrail".

Subsection 503.05 in the Standard Specifications is amended to provide that P.G. binder used in the asphaltic concrete will not be measured for payment, but shall be considered subsidiary to the item "Surfacing Under Guardrail".

Subsection 504.04 in the Standard Specifications is amended to provide that the application of a tack coat, including furnishing emulsified asphalt, will not be measured for payment, but shall be considered subsidiary to the item "Surfacing Under Guardrail".

The work and materials required for any drainage curb placed on surfacing under guardrail will not be measured and paid for, but will be considered subsidiary to the item "Surfacing Under Guardrail".


The work and materials required for surfacing under guardrail will be paid for at the contract unit price per square yard (square meter) for the item "Surfacing Under Guardrail". Payment will be full compensation for the work prescribed in these Special Provisions and the Standard Specifications.

* * * * *

Plan sheet 2-T3 is amended to include the attached "Surfacing Under Cable Guardrail" detail.

* * * * *

Upon execution of the contract, the plans will be revised to reflect these changes.

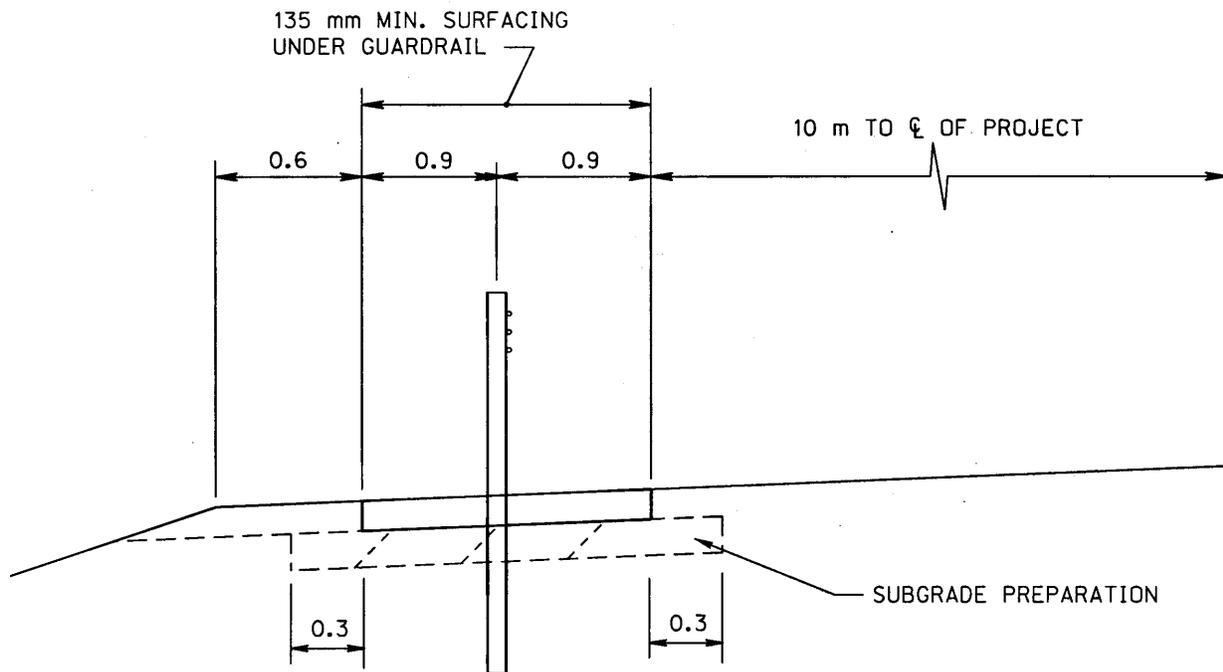

SURFACING UNDER CABLE GUARDRAIL

DEPARTMENT OF ROADS

Claude Oie
Construction Engineer

Issued: January 23, 2002

CO:F27AD102

NOTICE: Only the contractors issued bidding proposals receive this addendum and responsibility for notifying any potential subcontractors or suppliers remains with the contractor.